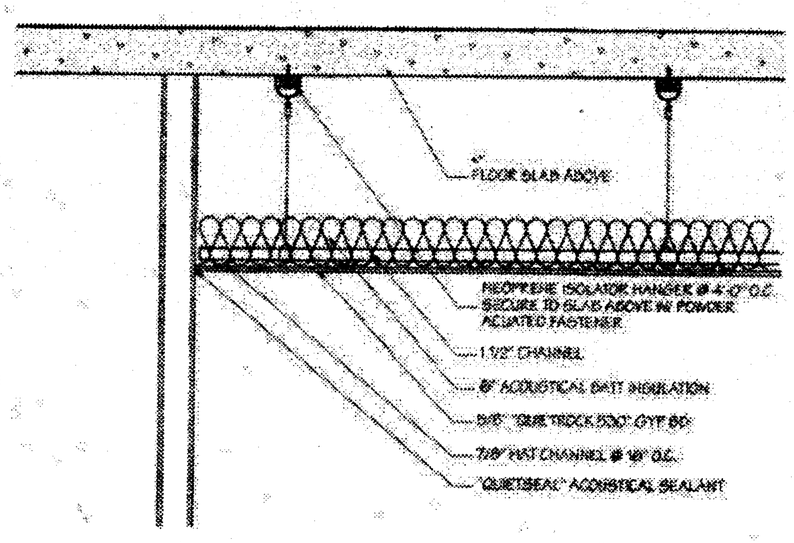

1 A-1 CEILING SECTION
SCALE: 1" = 1'-0"

NOTE:

1- NEOPRENE CEILING ISOLATION HANGERS TO BE EQUAL TO TYPE "ISOGRID 40" AS MFD BY KINETICS NOISE CONTROL 1-877-457-2605
2- SUPPORT CHANNELS SHALL NOT TOUCH ADJACENT PARTITIONS
3- "QUIETROCK 530" GYP BD AS MFD BY QUIET SOLUTION 1-800-797-8159 TO BE SCREWED AT 16" O.C. SPACING
4- BEFORE PUTTING UP NEXT SHEET OF "QUIETROCK" GYP BD, APPLY 1/8" BEAD OF "QUIETSEAL" SEALANT ON THE EDGE OF THE PANEL. INSTALL NEXT PANEL, SQUEEZING THE SEALANT IN BETWEEN THEM. REMOVE ANY EXCESS SEALANT.
5- USE FIBERGLAS TAPE AND JOINT COMPOUND TO FINISH GYP BD.
6- APPLY "QUIETSEAL" SEALANT AT WALL PERIMETER AND AT ANY OPENINGS IN CEILING PLANE (IE. ELECTRICAL CONDUIT, SPRINKLER LINES, ETC)

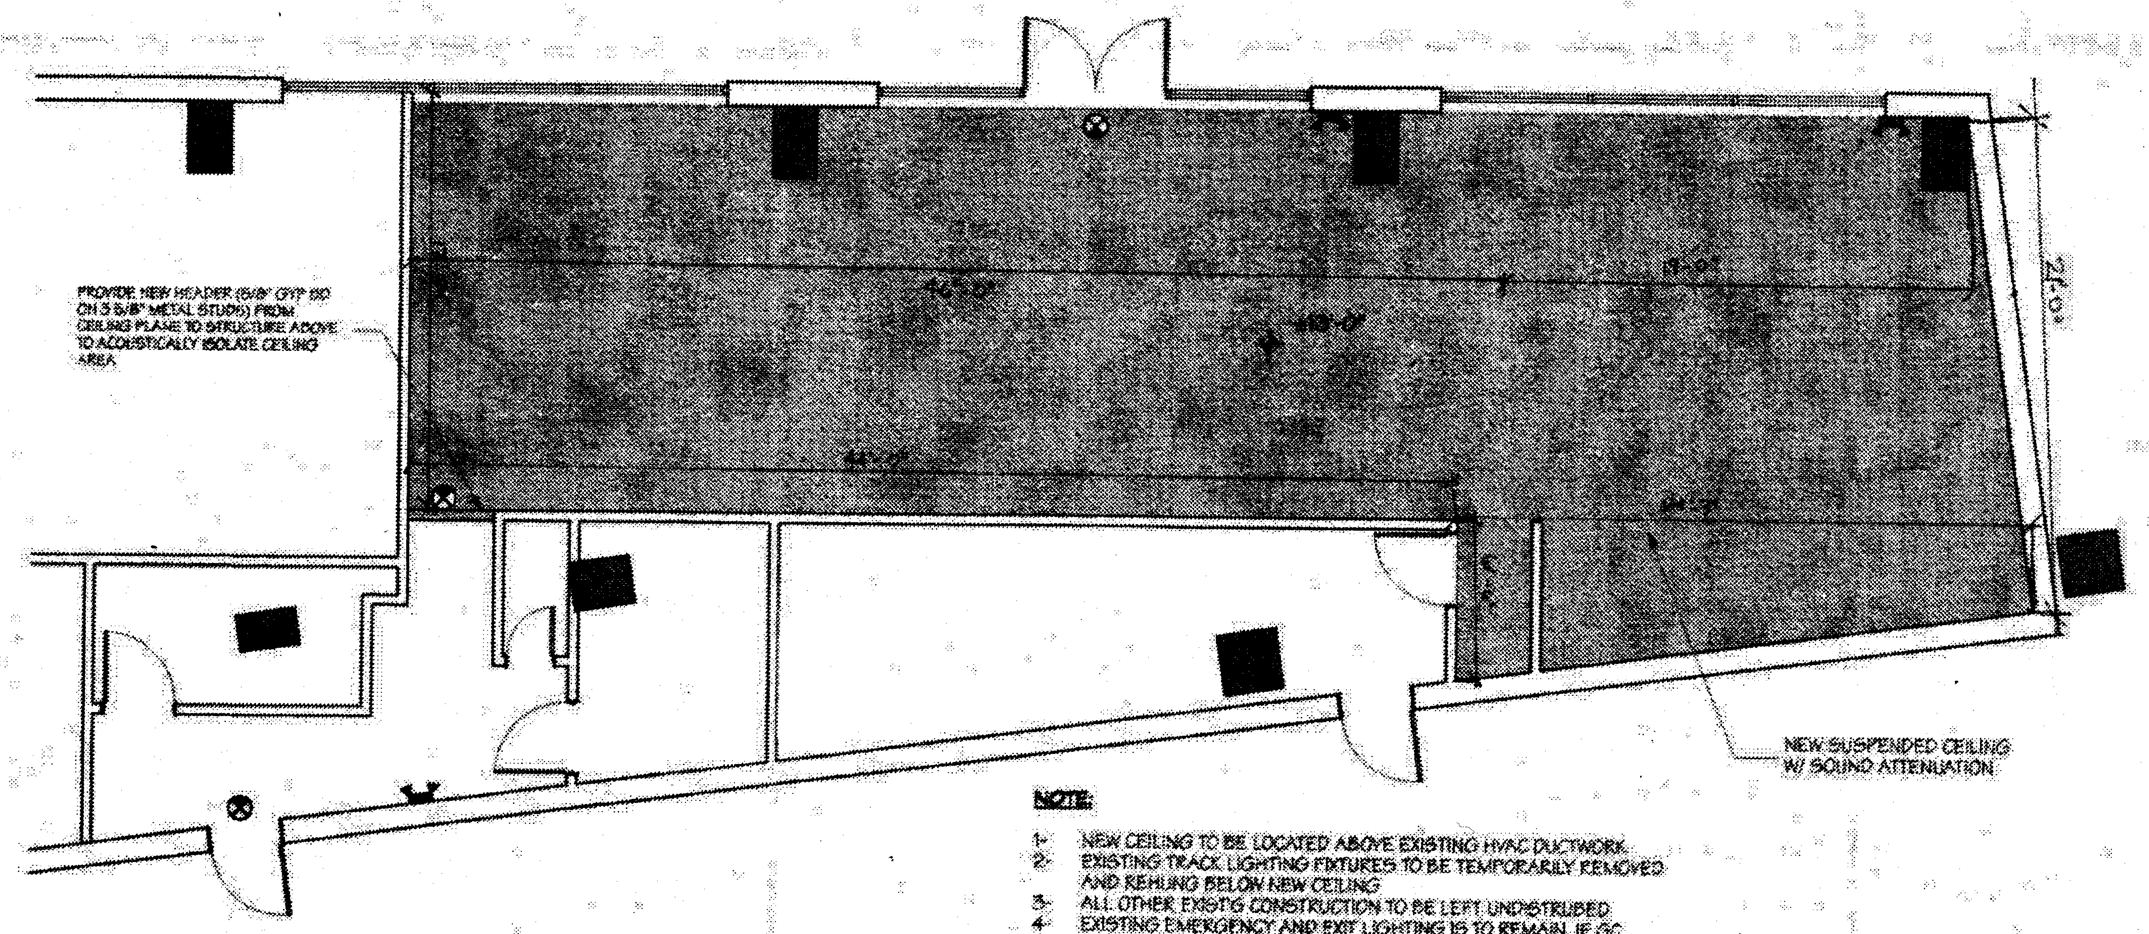

1 A-1 NEW CEILING PLAN
SCALE: 1/4" = 1'-0"

NOTE:

1- NEW CEILING TO BE LOCATED ABOVE EXISTING HVAC DUCTWORK.
2- EXISTING TRACK LIGHTING FIXTURES TO BE TEMPORARILY REMOVED AND REHUNG BELOW NEW CEILING
3- ALL OTHER EXISTING CONSTRUCTION TO BE LEFT UNDISTURBED
4- EXISTING EMERGENCY AND EXIT LIGHTING IS TO REMAIN. IF GC MUST REMOVE EMERGENCY OR EXIT LIGHTING DURING CONSTRUCTION TAKE CARE TO REINSTALL AT THE EXISTING LOCATIONS. VERIFY WORKING CONDITION AT JOB COMPLETION. REPAIR OR REPLACE AS REQ'D
5- IF ANY EXISTING SPRINKLER HEADS ARE LOCATED ABOVE NEW CEILING PLANE, MAKE ADJUSTMENTS TO DROP BELOW CEILING AS REQ'D