[illegible]

Date: 20JUL08

Drawing Title:  
FLOOR PLAN

Project Title:  
MADISON RIDGE BLDG 600  
MADISON RIDGE BUSINESS PARK  
WILLIAMS COUNTY, ND

Project Title:  
MADISON  
MADISON  
WILLIAMS


PHIA  
& ASSOC.  
Patrick Higgins  
Architects and Planner

605 Wayt Road  
Roswell, Georgia 30076  
(770)641-7583

Project No: \_\_\_\_\_

A-1

Sheet \_\_\_\_ of \_\_\_\_

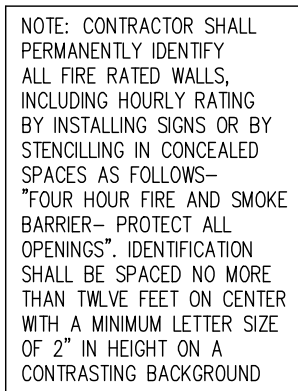

|    |            |
|----|------------|
| 2  | PART PLAN  |
| A1 | 1/4"=1'-0" |

## 1 RESTROOM NOTES

- WALL-HUNG LAV. FAUCET LEVER ACTUATED,  
HOT WATER AND DRAIN LINES EXPOSED BELOW TO BE  
INSULATED. LAVATORY TOP MTD. @ 34" A.F.F.,  
MAINTAIN 29" CLEAR TO LAVATORY SHORT, 27" CLEAR KNEE  
SPACE BELOW. LAVATORY PROJECTION MIN. 18" FROM WALL  
2. H<sub>2</sub>O WASH CLOSET, SEAT MOUNTED 18" A.F.F.  
3. 36" x 1 1/2" STAINLESS STEEL  
GRAB BAR MTD. 34" A.F.F.  
4. 42" x 1 1/2" STAINLESS STEEL  
GRAB BAR MTD. 34" A.F.F.  
5. PROVIDE TOILET PAPER DISPENSER MTD. 19" A.F.F.  
IN EACH H<sub>2</sub>O STALL  
6. PROVIDE SEAT DISPENSER AT EACH LAVATORY, MOUNT  
AT 40" A.F.F.  
7. PROVIDE PAPER TOWEL DISPENSER IN EACH BATH ROOM  
MTD. 40" A.F.F.  
7. PROVIDE 4" x 48" MIRROR AT EACH LAVATORY,  
BOT. EDGE MTD. 40" A.F.F.
- GENERAL NOTES:  
1. PORTABLE FIRE EXTINGUISHERS WILL BE PROVIDED PER NFPA STD. NO. 10. THE LOCATION AND ARRANGEMENT  
OF THE EXTINGUISHERS WILL BE DETERMINED BY AN INSPECTOR OF THE FIRE MARSHALS OFFICE PRIOR TO  
FINAL INSPECTION  
2. FIRE EMERGENCY SERVICES APPROVED KEY LOCK BOX WILL BE INSTALLED AT LOCATION NOTED ON PLAN  
3. UTILITY METERS, DISCONNECTS AND REAR DOORS SHALL BE MARKED WITH CONTRASTING LETTERS AND NUMBERS  
INDICATING TENANT SPACE THEY SERVE  
4. BUILDING ADDRESS NUMBER SHALL BE A MINIMUM 3 INCHES IN HEIGHT AND HAVE A MINIMUM STROKE WIDTH OF  
1/8" IN CONTRASTING COLOR TO THE BUILDING MATERIALS. NUMBERS SHALL BE LOCATED WHERE CLEARLY VISIBLE A  
FROM STREET OR ROADWAY. SEE FLOOR PLAN FOR LOCATION

GENERAL NOTES:

1. PORTABLE FIRE EXTINGUISHERS WILL BE PROVIDED PER NFPA STD. NO. 10. THE LOCATION AND ARRANGEMENT OF THE EXTINGUISHERS WILL BE DETERMINED BY AN INSPECTOR OF THE FIRE MARSHALS OFFICE PRIOR TO FINAL INSPECTION.
2. A FIRE EMERGENCY SYSTEMS APPROVED KEY LOCK BOX WILL BE INSTALLED AT LOCATION NOTED ON PLAN INDICATING TENANT SPACE THEY SERVE.
3. ALL EXISTING NUMBERS SHALL BE A MINIMUM 3 INCHES IN HEIGHT AND HAVE A MINIMUM STROKE WIDTH OF 1/2". NUMBERS SHALL BE IN CONTRASTING COLOR TO THE BUILDING MATERIALS. NUMBERS SHALL BE LOCATED WHERE CLEARLY VISIBLE AND LEGIBLE FROM STREET OR ROADWAY. SEE FLOOR PLAN FOR LOCATION.
4. EXISTING EXTERIOR LIGHTS SHALL BE REPLACED WITH LED LIGHTS AS NECESSARY TO PROVIDE MINIMUM CANDELA OF ONE FOOT-CANDLE.
5. PROVIDE DUCT SMOKE DETECTORS ON THE SUPPLY SIDE OF THE HVAC FAN CURTAIN FOR EACH SYSTEM EXCEEDING 200 CFM.