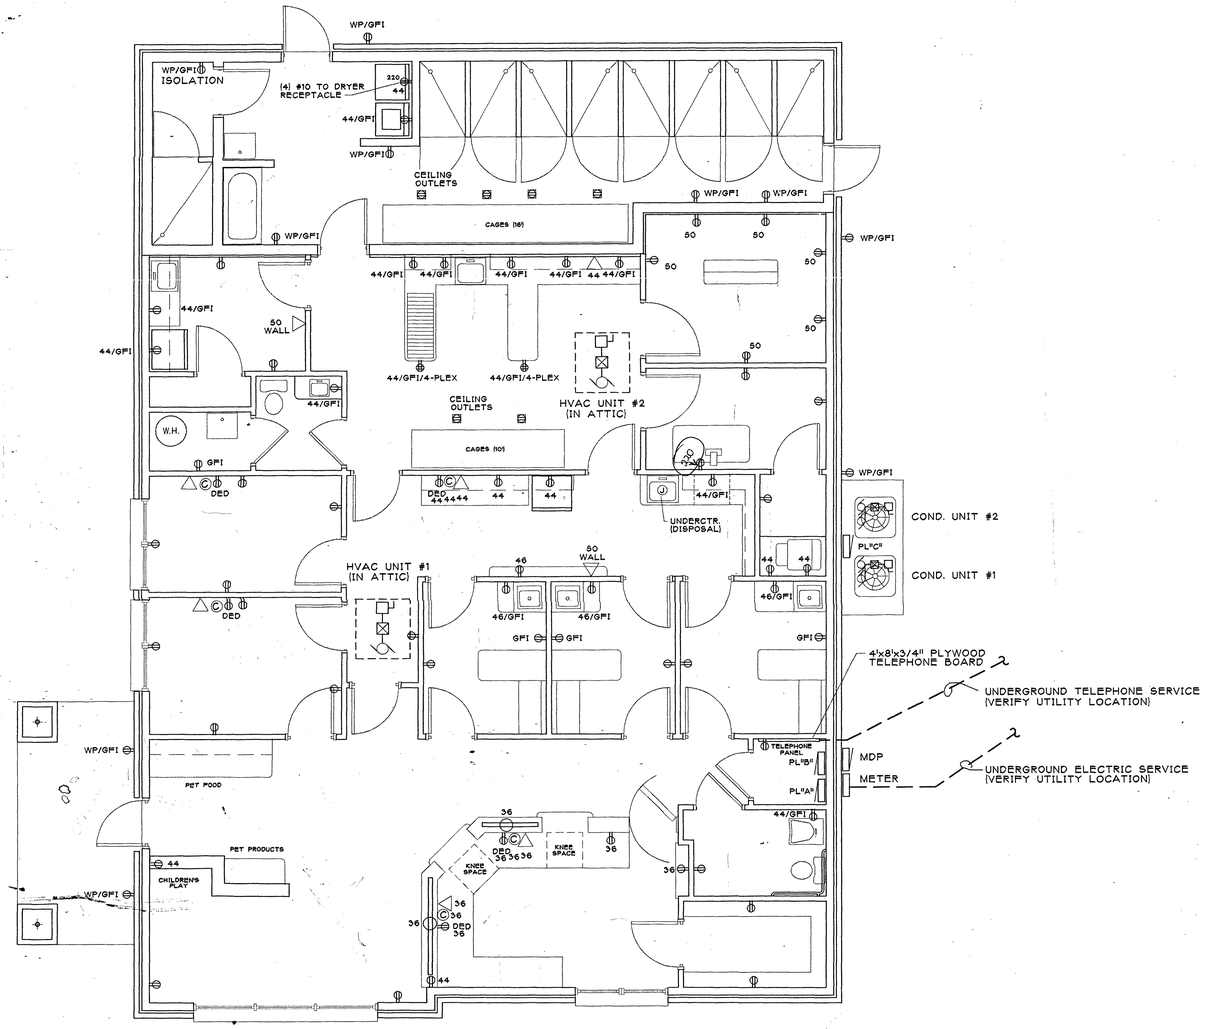

1 FLOOR PLAN
1/4" = 1'-0"

2 ELECTRICAL NOTES

1. THE ELECTRICAL SUBCONTRACTOR SHALL DESIGN AND INSTALL AN ELECTRICAL SYSTEM CONSISTING OF ALL FIXTURES, WIRING DEVICES, PLATES, PANELS, SWITCHES, CONDUIT, WIRE, FITTINGS, ITEMS AND APPURTENANCES AS MAY BE NECESSARY FOR A COMPLETE AND OPERATIONAL ELECTRICAL SYSTEM OR SYSTEMS, INCLUDING ALL PARTS ANCILLARY TO THE SYSTEM OR SYSTEMS.
2. THE ELECTRICAL SYSTEM AND DESIGN SHALL COMPLY IN EVERY RESPECT WITH THE RULES AND REGULATIONS OF THE NATIONAL ELECTRIC CODE, NATIONAL BOARD OF FIRE UNDERWRITERS, LOCAL CODES, STATE STATUTES AND FEDERAL CODES.
3. THE ELECTRICAL SUBCONTRACTOR SHALL PROVIDE ELECTRIC SERVICE OF SUFFICIENT SIZE TO ALL HVAC UNITS AND CONDENSERS. THE SUBCONTRACTOR SHALL VERIFY THE LOCATION AND SIZE OF SERVICE REQUIRED FOR ALL UNITS.
4. THE ELECTRICAL SUBCONTRACTOR SHALL CONNECT THE REQUIRED BUILDING SERVICE TO THE MAIN ELECTRIC UTILITY SERVICES. THE SUBCONTRACTOR SHALL BE RESPONSIBLE FOR THE COORDINATION OF THE CONNECTION WITH AUTHORITIES, PAYMENT OF DEPOSIT AND APPLICABLE FEES.
5. VERIFY COMPUTER LOCATIONS, COMPUTER POWER REQUIREMENTS AND COMPUTER OUTLET TYPES WITH OWNER.
6. OWNER SHALL SUPPLY AND INSTALL TELEPHONE SYSTEM. ELECTRICAL SUBCONTRACTOR SHALL INSTALL TELEPHONE WALL BOXES (STUB ABOVE CEILING).

3 ELECTRICAL SYMBOLS

SYMBOL	DESCRIPTION
	INCANDESCENT LIGHT FIXTURE
	WALL MOUNTED INCANDESCENT LIGHT FIXTURE
F	FLUORESCENT LIGHT FIXTURE
NL	NIGHT LIGHT, HOT WIRED LIGHT FIXTURE
EM	EMERGENCY FIXTURE, WITH AUXILLARY POWER SUPPLY
	EXHAUST FAN
	CEILING FAN
$	SINGLE POLE SWITCH
$3	
$4	4-WAY SWITCH
$D	DIMMER SWITCH
$R	RHEOSTAT SWITCH
	DUPLEX OUTLET / STANDARD MOUNTING HEIGHT (12" ABOVE F.F. TO CENTER)
42	DUPLEX OUTLET / MOUNTING HEIGHT ABOVE F.F. IN INCHES TO CENTER
42	OUTLET STRIP / MOUNTING HEIGHT ABOVE F.F. IN INCHES TO CENTER
	FLOOR DUPLEX OUTLET
	CEILING DUPLEX OUTLET
WP	WEATHERPROOF DUPLEX OUTLET
GFI	GROUND FAULT INTERRUPTER DUPLEX OUTLET
DED	DEDICATED CIRCUIT DUPLEX OUTLET W/SURGE PROTECTION
	FOURPLEX OUTLET
220	220/240 VOLT OUTLET
	TELEPHONE OUTLET
	FLOOR TELEPHONE OUTLET
C	COMPUTER OUTLET
S	SMOKE DETECTOR, HARD-WIRED
	DISCONNECT SWITCH
	MAGNETIC CONTACTOR
	ELECTRIC MOTOR
J	JUNCTION BOX
T	TIMER SWITCH

N

CHAPEL ASSOCIATES ARCHITECTS, INC.
PAVILION IN THE PARK, 8201 CANTRELL ROAD, SUITE 360
LITTLE ROCK, ARKANSAS 72227-2453 / (501) 225-5900

FLOOR PLAN - ELECTRICAL POWER

A NEW BUILDING FOR
OTTER CREEK ANIMAL HOSPITAL
#1 OTTER CREEK COURT, LITTLE ROCK, ARKANSAS

REVISIONS

02/20/01

E1

SHEET of

© COPYRIGHT 2001