


P:\Projects\2012\A12036 - 953 Industrial Way\Condo\A12036-A1.1-Egress Plans.dwg, A1.1, Oct 12, 2012 4:25pm, Slogar


D10 PROPOSED SECOND FLOOR PLAN

SCALE: 1/8" = 1'-0"



H10 ARCHITECTURAL SITE PLAN & GROUND FLOOR PLAN

SCALE: 1/8" = 1'-0"



ACCESSIBLE PATH OF TRAVEL NOTES

- THIS PATH SHALL BE PROVIDED FROM THE ACCESSIBLE PARKING LOADING/UNLOADING ZONE TO THE MAIN ENTRANCE WITH A MAX. SLOPE OF 1:20 UNLESS AN APPROVED RAMP IS USED.
- THIS PATH SHALL BE A MIN. OF 48" WIDE WITH A NON-SIP SURFACE.
- THIS PATH SHALL BE AT THE SAME LEVEL AS THE FINISH FLOOR OF THE MAIN ENTRANCE WITH A MAX. THRESHOLD HEIGHT OF 1/2". REFER TO DETAIL IN THIS SET OF PLANS.
- THIS PATH SHALL HAVE A MAX. CROSS SLOPE OF 2% AND A MAX. RUNNING SLOPE OF 5%. SLOPES HIGHER THAN THIS SHALL BE APPROVED BY THE BUILDING OFFICIAL.
- REFER TO DOOR CLEARANCE REQUIREMENTS.
- THIS PATH SHALL HAVE A CONTINUOUS COMMON SURFACE, NOT INTERRUPTED BY STEPS OR BY ABRUPT CHANGES IN LEVEL EXCEEDING 1/2", AND SHALL BE A MIN. 48" IN WIDTH.
- THIS PATH SHALL BE SLIP-RESISTANT AS FOLLOWS:
 - SURFACES WITH A SLOPE OF LESS THAN 6% GRADIENT SHALL BE AT LEAST AS SLIP-RESISTANT AS THAT DESCRIBED AS A MEDIUM SALTED FINISH.
 - SURFACES WITH A SLOPE OF 6% GRADIENT SHALL BE SLIP RESISTANT.
- PROVIDE TACTILE EXIT SIGN WITH ASSOCIATED GRADE 2 BRAILLE AS REQUIRED TO BE IN CONFORMANCE WITH IBC. EXIT AT EACH GRADE LEVEL EXTERIOR SIGN, PROVIDING SIGN STATING "EXIT ROUTE" AT EXIT DOORS TO HALL OR CORRIDOR THAT IS REQUIRED TO HAVE A VISUAL EXIT SIGN. REFER TO DETAIL.
- PROVIDE ACCESSIBLE ENTRANCE PLAQUE AND OR DECAL AT EACH BUILDING ENTRANCE PER IBC. REFER TO DETAIL.
- WALKS SHALL BE PROVIDED WITH A LEVEL AREA NOT LESS THAN 60"x60" AT A DOOR OR GATE THAT SWINGS TOWARD THE WALK AND NOT LESS THAN 48" WIDE BY 44" DEEP AT A DOOR OR GATE THAT SWINGS AWAY FROM THE WALK.
- WALKS SHALL EXTEND A MINIMUM OF 24" TO THE SIDE OF THE STRIKE EDGE OF A DOOR OR GATE THAT SWINGS TOWARD THE WALK.
- ALL WALKS WITH CONTINUOUS GRADIENTS SHALL HAVE LEVEL AREAS AT LEAST 5' IN LENGTH AT INTERVALS OF AT LEAST EVERY 400'.
- WALKS, SIDEWALKS AND PEDESTRIAN WAYS SHALL BE FREE OF GRATING WHENEVER POSSIBLE. FOR GRATINGS LOCATED IN THE SURFACE OF ANY OF THESE AREAS, GRID OPENINGS IN GRATINGS SHALL BE NO GREATER THAN 1/2" WIDE IN ONE DIRECTION. IF GRATINGS HAVE ELONGATED OPENINGS, THEY SHALL BE PLACED SO THAT THE LONG DIMENSION IS PERPENDICULAR TO THE DOMINANT DIRECTION OF TRAVEL.

EXIT SIGNAGE LEGEND

- SEE ELECTRICAL PLANS FOR ILLUMINATED EXIT SIGNS.
- SEE DETAIL F6/A-2.3 FOR TACTILE SIGN (PER CBC 1011.3)

EXIT SIGN SYMBOL	TACTILE SIGN WORDING (PER CBC 1011.3)
*1	EXIT SIGN 1: "EXIT"
*2	EXIT SIGN 2: "EXIT ROUTE"

EGRESS EXITING REQUIREMENTS

DOOR NO.	NUMBER OF OCCUPANTS	WIDTH RATIO	REQUIRED WIDTH	PROVIDED WIDTH	ACTUAL WIDTH
DOOR #1	27	0.2"	5.4'	72"	69"
DOOR #2	33	0.2"	6.6'	36"	33"
DOOR #3	27	0.2"	5.4'	36"	33"
DOOR #4	8	0.2"	1.4'	72"	69"
DOOR #5	8	0.2"	1.4'	36"	33"
DOOR #6	15	0.2"	3.0'	36"	33"
DOOR #7	6	0.2"	1.2'	36"	33"
DOOR #8	8	0.2"	1.4'	36"	33"
DOOR #9	7	0.2"	1.4'	36"	33"
DOOR #10	16	0.2"	3.2'	36"	33"
DOOR #11	8	0.2"	1.4'	36"	33"
DOOR #12	6	0.2"	1.2'	36"	33"

* DOORS, WHEN FULLY OPENED, AND HANDRAILS SHALL NOT REDUCE THE REQUIRED MEANS OF EGRESS WIDTH BY MORE THAN 7". DOORS IN ANY POSITION SHALL NOT REDUCE THE REQUIRED WIDTH BY MORE THAN ONE-HALF.

OCCUPANT LOAD PER EXIT


MAXIMUM OCCUPANT LOAD SIGN MOUNTED IN CONSPICUOUS SPACE NEAR THE MAIN EXIT OR EXIT ACCESS DOORWAY PER CBC 1004.3



STUDIO
ARCHITECTS

1540 MARSH STREET, STE. 150
SAN LUIS OBISPO, CA 93401
+805/547.2240 +805/547.2241
ARRISSTUDIOARCH.COM
THOMAS E. JESS ARCHITECT #C23428
STEPHEN BROOK ARCHITECT #C23422

Architect of Record/Consultant

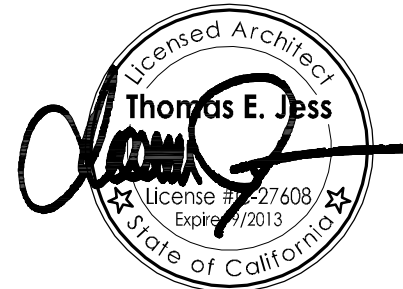

Consultant

Client
BPR PROPERTIES
591 Lytton Avenue
Palo Alto, CA 94301
Phone: 650.223.6711
Fax: 650.328.2924

Project
BPR PROPERTIES
INTERIOR OFFICE IMPROVEMENTS
953 Industrial Ave
Palo Alto, CA
GROUND FLOOR
EGRESS PLAN

NO. REVISION DATE

1 CONSULTANT REQUESTED CHANGES 10/04/2012

Project

A12036

Date

September 21, 2012

Sheet

A1.1