


NOTES:

① CONCRETE PAVING TO BE 4" THICK, JOINTED @ 10'-0" O.C. EACH WAY. ALL JOINTS MAY BE SAWN BUT MUST BE RESAWN 1/8" X 1-1/2" 1ST TIME SCRIBED, 2ND TIME FOR A 3/8" X 1/2" DEEP JOINT. CONTRACTOR MAY TOOL JOINT 1/8" X 1-1/4" - USE TBAR IF REQUIRED. ALL JOINTS TO BE SEALED WITH 1 PART POLYURETHANE SEALANT.

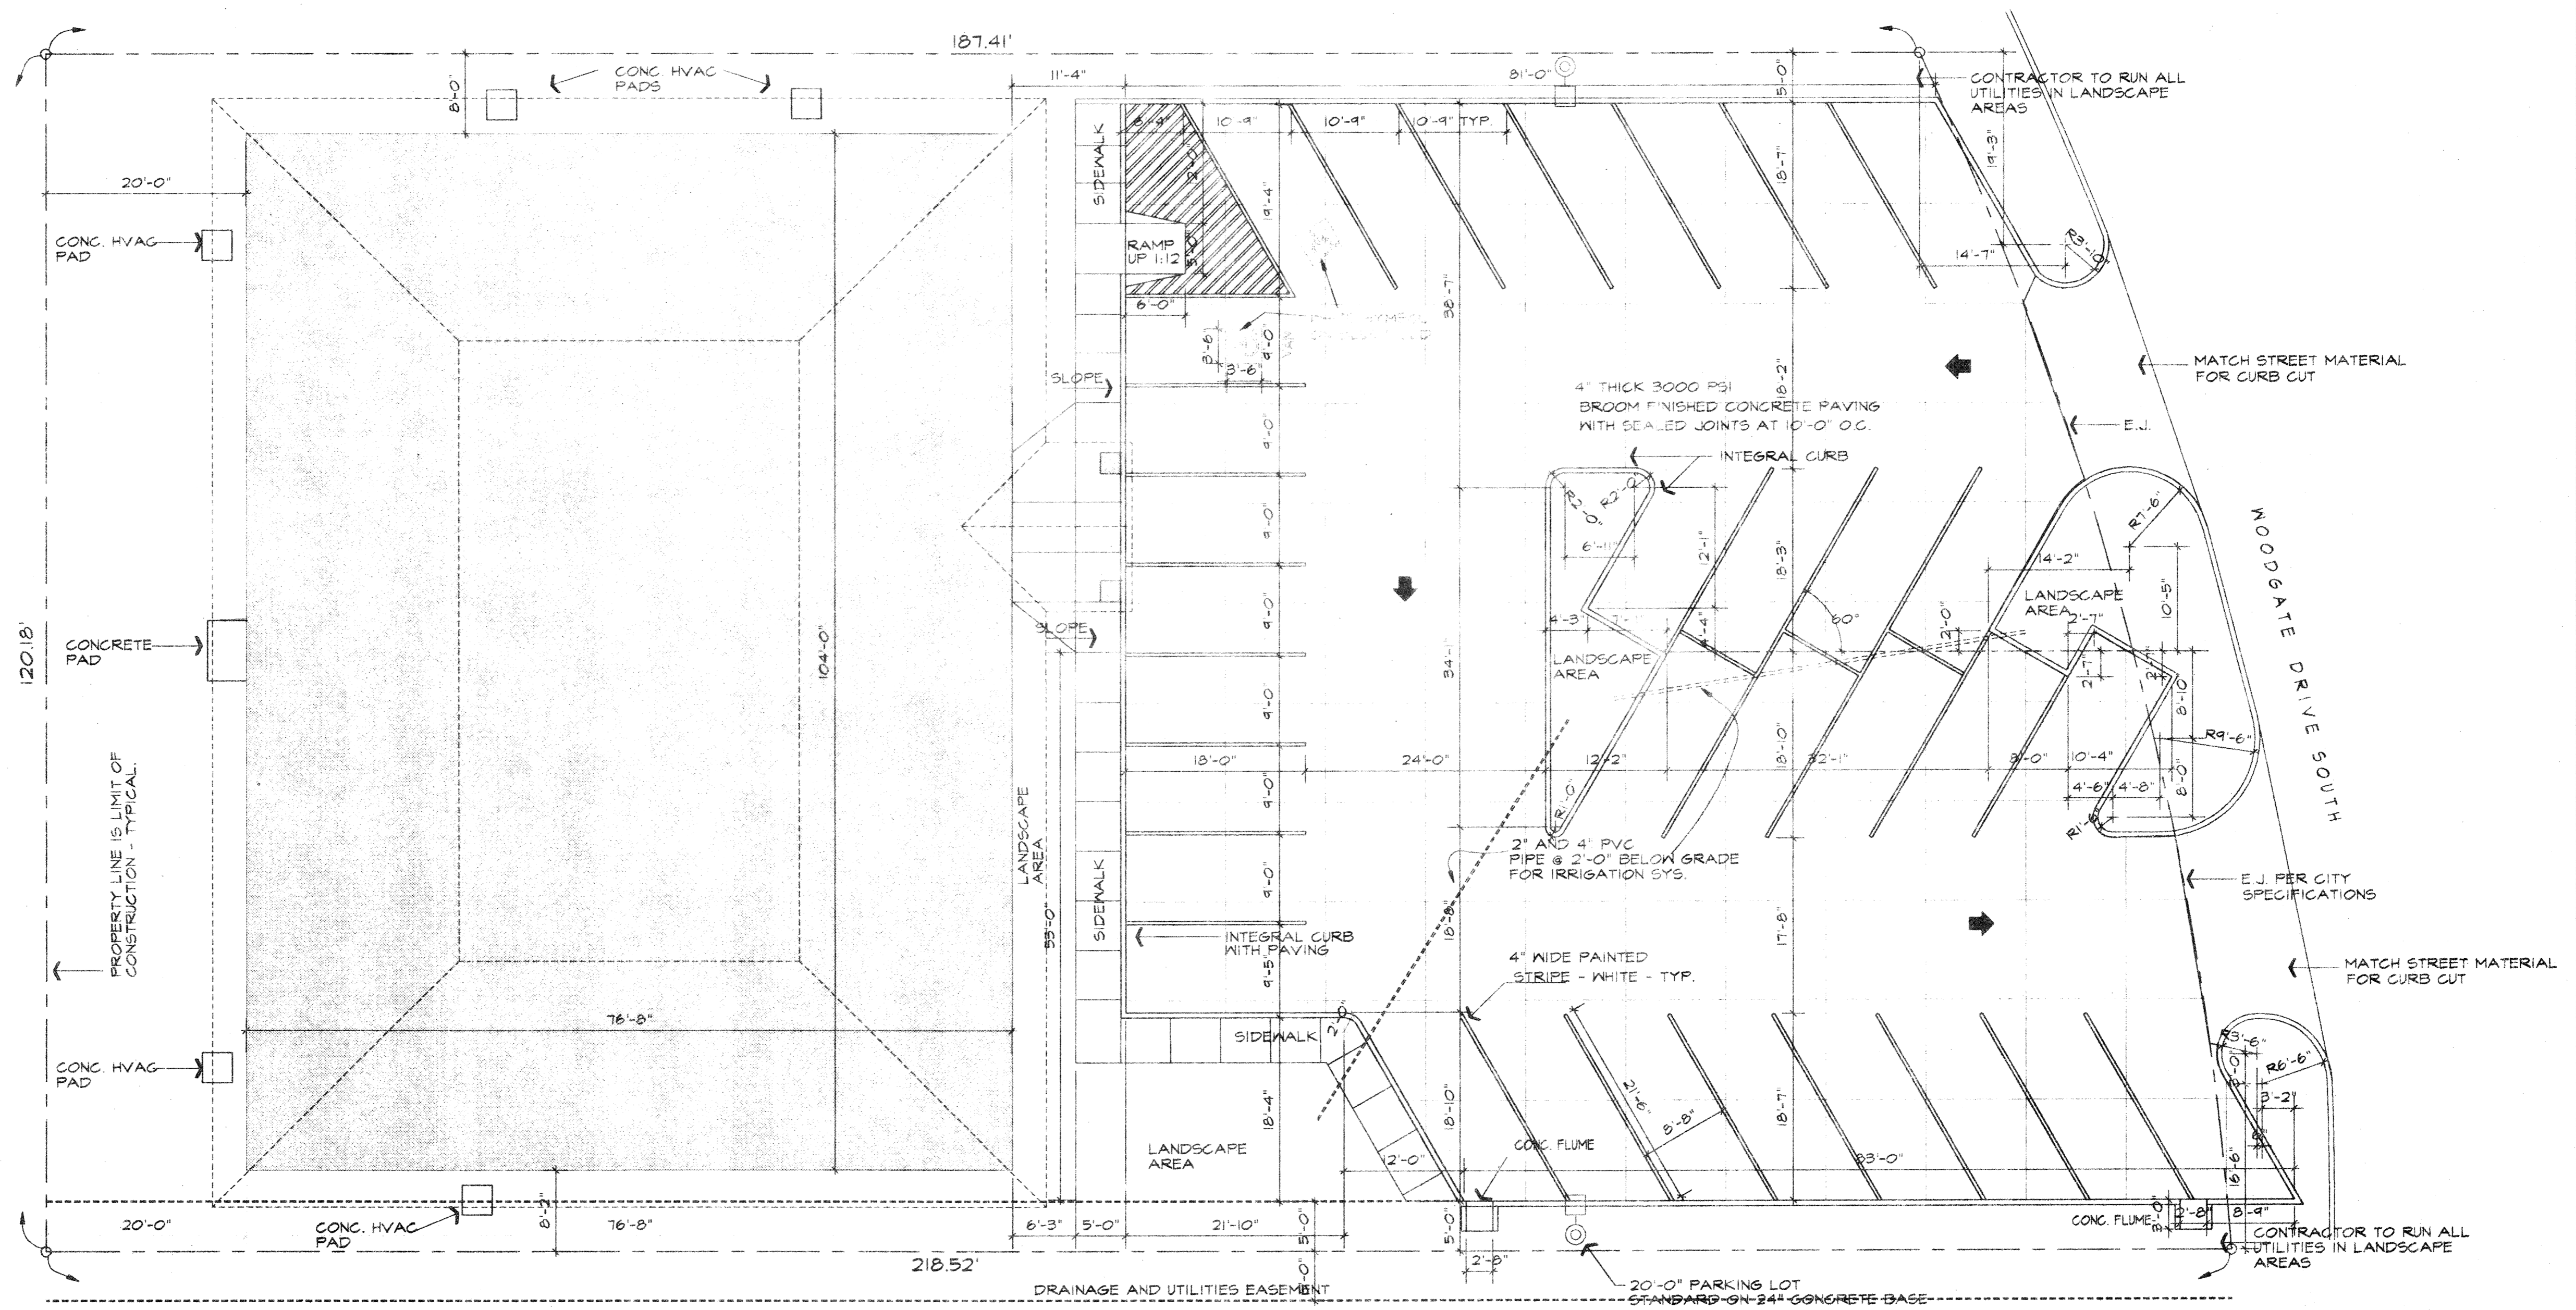

SITE PLAN

2.1

1" = 10'-0"

AN OFFICE BUILDING FOR ENTEX
BRANDON, MS.

PROJECT:
DATE:

2.1