


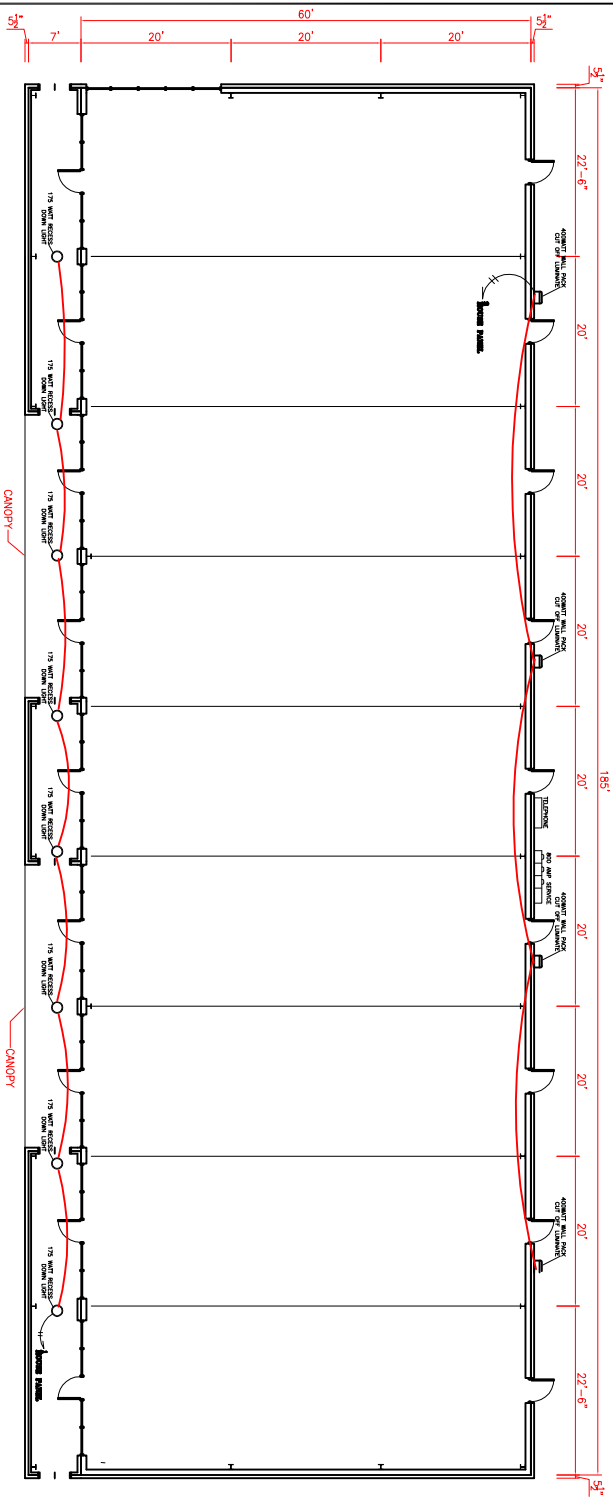

OCCUPANCY CLASS : RETAIL
MULTITENANT : NO
SHELL ONLY : NO
TYPE OF CONST. : METAL BUILDING II B
PROTECTED : NO
FLOOR AREA : 1,100
OFFICE sq. ft. : 220
SHOWROOM sq. ft. : 1,100
BASEMENT : NO
BASIC BLDG. : NO
UNITS : 1
STORIES : 1

PANEL BOX SUITE 108(RECP.)

EQUIPMENT	AMP	POLE	CIR	CIR	POLE	AMP	EQUIPMENT
RECEIPT	20	1	1	2	1	20	G.F.I REC.
RECEIPT	20	1	3	4	1	20	G.F.I REC.
LIGHTING	20	1	5	6	1	20	LIGHTING
LIGHTING	20	1	7	8	1	20	LIGHTING
HVAC	30	2	9	10	1	20	FM LIGHTING
HVAC	30	2	11	12	1	20	W.H.
FURNACE	20	1	13	14			SPARE
SPARE			15	16			SPARE
SPARE			17	18			SPARE
SPARE			19	20			SPARE

ELECTRICAL SYMBOLS

	SURFACE MOUNTED FLUORESCENT FIXTURE & OUTLET
	RECESSED FLUORESCENT FIXTURE & OUTLET
	LIGHTING FIXTURE CONNECTED TO UNSWITCHED CIRCUIT
	FLUORESCENT STRIP LIGHT
	FLUORESCENT FIXTURE AND OUTLET RECESSED
	INCANDESCENT WALL-MOUNTED FIXTURE
	INCANDESCENT WALL-MOUNTED FIXTURE
	BACK FACE/HOOD STEEL PROBE DIRECTIONAL ARROWS AS REQUIRED
	EXIT LIGHT CEILING MOUNTED SINGLE UNIT SERIES W/BATTERY PACK
	BACK FACE/HOOD STEEL PROBE DIRECTIONAL ARROWS AS REQUIRED
	SINGLE RECEPTACLE - 20A/120V 15' AFF UNLESS OTHERWISE NOTED
	SPECIAL RECEPTACLE - NEMA TYPE AS NOTED
	DUPLEX RECEPTACLE 42' AFF UNLESS OTHERWISE NOTED
	TELEPHONE OUTLET 18' AFF UNLESS OTHERWISE NOTED
	PANEL BOARD
	FLEXIBLE CONNECTION
	CONDUIT AND WIRE CONCEALED IN FLOOR
	CONDUIT AND WIRE EXPOSED
	ABOVE FINISHED FLOOR
	WALL, CEILING, FLOOR, ETC. 1500' UNLESS OTHERWISE NOTED
	GROUND FAULT INTERRUPTING
	WEATHERPROOF - NEMA 3R
	WALL MOUNTED BATTERY PACK LIGHTING FIXTURE

PANEL BOX SUITE 108(LIGHTING & EQUIPMENT)

EQUIPMENT	AMP	POLE	CIR	CIR	POLE	AMP	EQUIPMENT
RECEIPT	20	1	1	2	1	20	G.F.I REC.
RECEIPT	20	1	3	4	1	20	G.F.I REC.
LIGHTING	20	1	5	6	1	20	LIGHTING
LIGHTING	20	1	7	8	1	20	LIGHTING
HVAC	30	2	9	10	1	20	FM LIGHTING
FURNACE	20	1	13	14			SPARE
SPARE			15	16			SPARE
SPARE			17	18			SPARE
SPARE			19	20			SPARE

PANEL BOX HOUSE PANEL

EQUIPMENT	AMP	POLE	CIR	CIR	POLE	AMP	EQUIPMENT
LIGHTING	20	1	1	2			SPARE
LIGHTING	20	1	3	4			SPARE
SPARE			5	6			SPARE
SPARE			7	8			SPARE
SPARE			9	10			SPARE
SPARE			11	12			SPARE
SPARE			13	14			SPARE
SPARE			15	16			SPARE
SPARE			17	18			SPARE
SPARE			19	20			SPARE



Metal Building Associates
Sugar Hill, GA 30518
Phone: (770) 945-2883
Fax: (770) 614-9081
Contact: Greg Thigpen

STAMP

PROJECT
DAVID HASELL
SPEC SPACE SUITE 105
1944 BRASELTON HWY.

Date 2/08/2006
File Name ptreemarket60x185-013106-2
Project Number
Checked By

Floor Plan

A-3